


# Meter Pole Requirements for Central Al. Electric Cooperative

## Pole Must be 20' Long, Treated, & Minimum 6" Round Diameter Pole

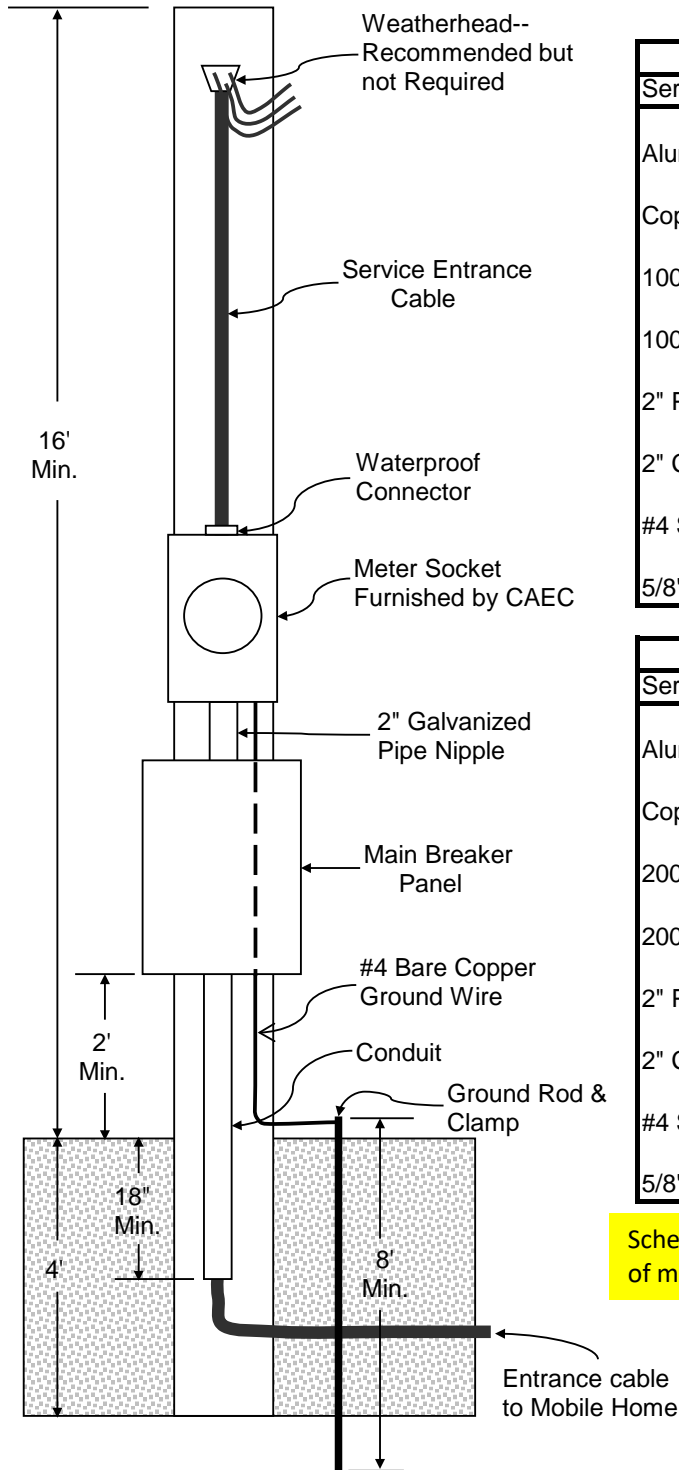

### Materials Required

100 AMP
Service Entrance Cable Sizes
Aluminum---#2
Copper--#4
100 AMP Meter Socket
100 AMP Main Breaker Panel
2" Pipe Nipple
2" Conduit
#4 Solid Bare Copper Ground Wire
5/8"x8' Galvanized or Copper Ground Rod

200 AMP
Service Entrance Cable Sizes
Aluminum---#4/0
Copper--#2/0
200 AMP Meter Socket
200 AMP Main Breaker Panel
2" Pipe Nipple
2" Conduit
#4 Solid Bare Copper Ground Wire
5/8"x8' Galvanized or Copper Ground Rod

Schedule appointment with staking engineer for location of meter pole before installing

Round poles can be purchased at Russell Do-it Center in Prattville, Wetumpka, and Clanton. Square 6X6 poles are not recommended, but can be used.